


**GENERAL NOTES**

01. ALL DIMENSION ARE IN MILLIMETERS.
02. THE SETTING OUT AND LEVELS TO BE VERIFIED ON SITE PRIOR TO THE COMMENCEMENT OF WORKS.
03. ENTRANCE SHALL BE PROVIDED AS SHOWN ON THE DRAWINGS.
04. UNLESS SPECIFIED OTHERWISE, ALL WELDS SHALL BE 6MM CONTINUOUS FILLET WELD.
05. ALL CONCRETE SHALL BE GRADE 200/20 THE USE OF RECYCLED AGGREGATES SHALL BE CONSIDERED.
06. HOARDING SHOULD NOT BE REMOVED BEFORE COMPLETION OF CONSTRUCTION WORKS.
07. CONTRACTOR SHOULD MAINTAIN THE HOARDING IN A SAFE AND TIDY CONDITION.
08. AT REMOVAL OF HOARDING, CONTRACTOR SHOULD REINSTATE SURFACE TO MATCH ADJOINING FINISHES.
09. ALL STRUCTURAL STEEL TO BE S275 AND COMPLY WITH BS EN 10025 OR EQUIVALENT. ALL STEELWORKS TO COMPLY WITH STRUCTURAL USE OF STEEL, HONG KONG 2005.
10. ALL STEEL WORKS SHALL BE PAINTED WITH TWO LAYERS OF PRIMER COAT FOR PROTECTION.
11. ALL WELDING SHALL COMPLY WITH BS EN 10011.
12. ALL CORRUGATED STEEL SHEET PANELS, CAPPINGS AND TOE SHEETS SHOULD BE OF GALVANIZED STEEL WITH MINIMUM ZINC COATING CONTENT 350g/m WITH TRIPLE-SPOT TEST, AND BE FINISHED ON BOTH SURFACES WITH ONE UNDERCOAT OF "LUXAPRIME 1600 PRIMER" OR EQUIVALENT AND TWO FINISHING COATS OF SYNTHETIC PAINT OF ALKYD RESIN BASE.
13. ALL EXPOSED SURFACES OF METAL WORK SHOULD BE PAINTED IN MID-GREY COLOUR (10 A 07) UNLESS STATED OTHERWISE.
14. ArchSD LOGO SHOULD BE PAINTED AT A 3-BAY INTERVAL. IF THERE ARE OTHER LOGOS TO BE DISPLAYED, THE SPECIFIED LOGO AND THE ArchSD LOGO SHOULD BE PAINTED ALTERNATIVELY AT A 3-BAY INTERVAL.
15. A TEMPORARY LIGHTING SYSTEM SHALL BE PROVIDED FOR ALL HOARDING AND COVERED WALKWAYS AND BE MAINTAINED IN GOOD ORDER BY THE CONTRACTOR FOR THE DURATION OF WORKS. THE AVERAGE ILLUMINANCE ON THE FLOOR LEVEL SHALL BE WITHIN THE RANGE OF 35 LUX TO 50 LUX. THE HOARDING SHALL BE PROPERLY LIT AT NIGHT.
16. THE HOARDING, COVERED WALKWAY, GANTRY INCLUDING ITS FOUNDATION MUST NOT OBSTRUCT ANY DRAINAGE CHANNELS, THE ACCESS TO UTILITY PITS AND OPENING OF THE PIT COVERS AT ALL TIMES.
17. WIND LOAD SHALL COMPLY TO CODE OF PRACTICE ON WIND EFFECTS IN HONG KONG 2004.
18. DESIGN LOADS: BASIC WIND PRESSURE = 1.82 kPa (GENERAL TERRAIN)  
FOR HOARDING, WIND COEFFICIENT = 1.4  
REDUCTION FACTOR = 0.37 (PNAP 71)
19. THE ROOF OF COVERED WALKWAY SHALL BE DESIGNED TO SUPPORT A UNIFORMLY DISTRIBUTED LOAD OF 5.0kPa AND 20kN POINT LOAD, WHICHEVER IS THE GREATER.
20. GROUND BEARING PRESSURE  
ALLOWABLE GROUND BEARING PRESSURE:  
WITHOUT WIND: 50kPa  
WITH WIND 62.5kPa
21. THE INTERNAL LAYOUT OF THE SITE SHALL BE SO ARRANGED THAT NO BACKING IN/OUT MOVEMENT OF CONSTRUCTION TRAFFIC IS REQUIRED.
22. NO REVERSING MOVEMENT OF CONSTRUCTION VEHICLES FROM/TO THE CONSTRUCTION SITE SHALL BE PERMITTED.
23. NO CONSTRUCTION VEHICLES SHALL BE PERMITTED TO QUEUE AND WAIT OUTSIDE THE CONSTRUCTION SITE.
24. ALL LOADING/UNLOADING ACTIVITIES OF CONSTRUCTION VEHICLES WILL BE CONFINED WITHIN THE CONSTRUCTION SITE.
25. NO ADVERTISEMENTS OTHER THAN A DESCRIPTION OF THE BUILDING AND THE NAME OF ANY PERSONS CONCERNED FOR THIS CONSTRUCTION SHALL BE DISPLAYED ON ANY PART OF THE HOARDING OR COVERED WALKWAY.
26. WHERE ANY HOARDING, COVERED WALKWAY OF GANTRY IS ERECTED NEAR ANY LIVE WIRE OR CABLE, THE PERMITTEE SHALL ARRANGE WITH THE OWNERS OF SUCH WIRE OR CABLE TO TAKE NECESSARY PRECAUTIONS TO RENDER SAFE SUCH WIRE OR CABLE.
27. THE HOARDING SHALL NOT OBSCURE ANY TRAFFIC SIGNS OR TRAFFIC SIGNALS.
28. THE HOARDING WORKS SHALL NOT ADVERSELY AFFECT THE STABILITY OF ANY NEARBY SLOPES.

**LEGEND**

- + 64.50 EXISTING LEVEL
- 68.00 — EARTH MOUND CONTOUR LINE
- - - - - EXISTING SLOPE LINE
- - - - - BOUNDARY LINE
- PLASTER OR CEMENT RENDERING
- STEEL
- R.C. WALL OR SLAB

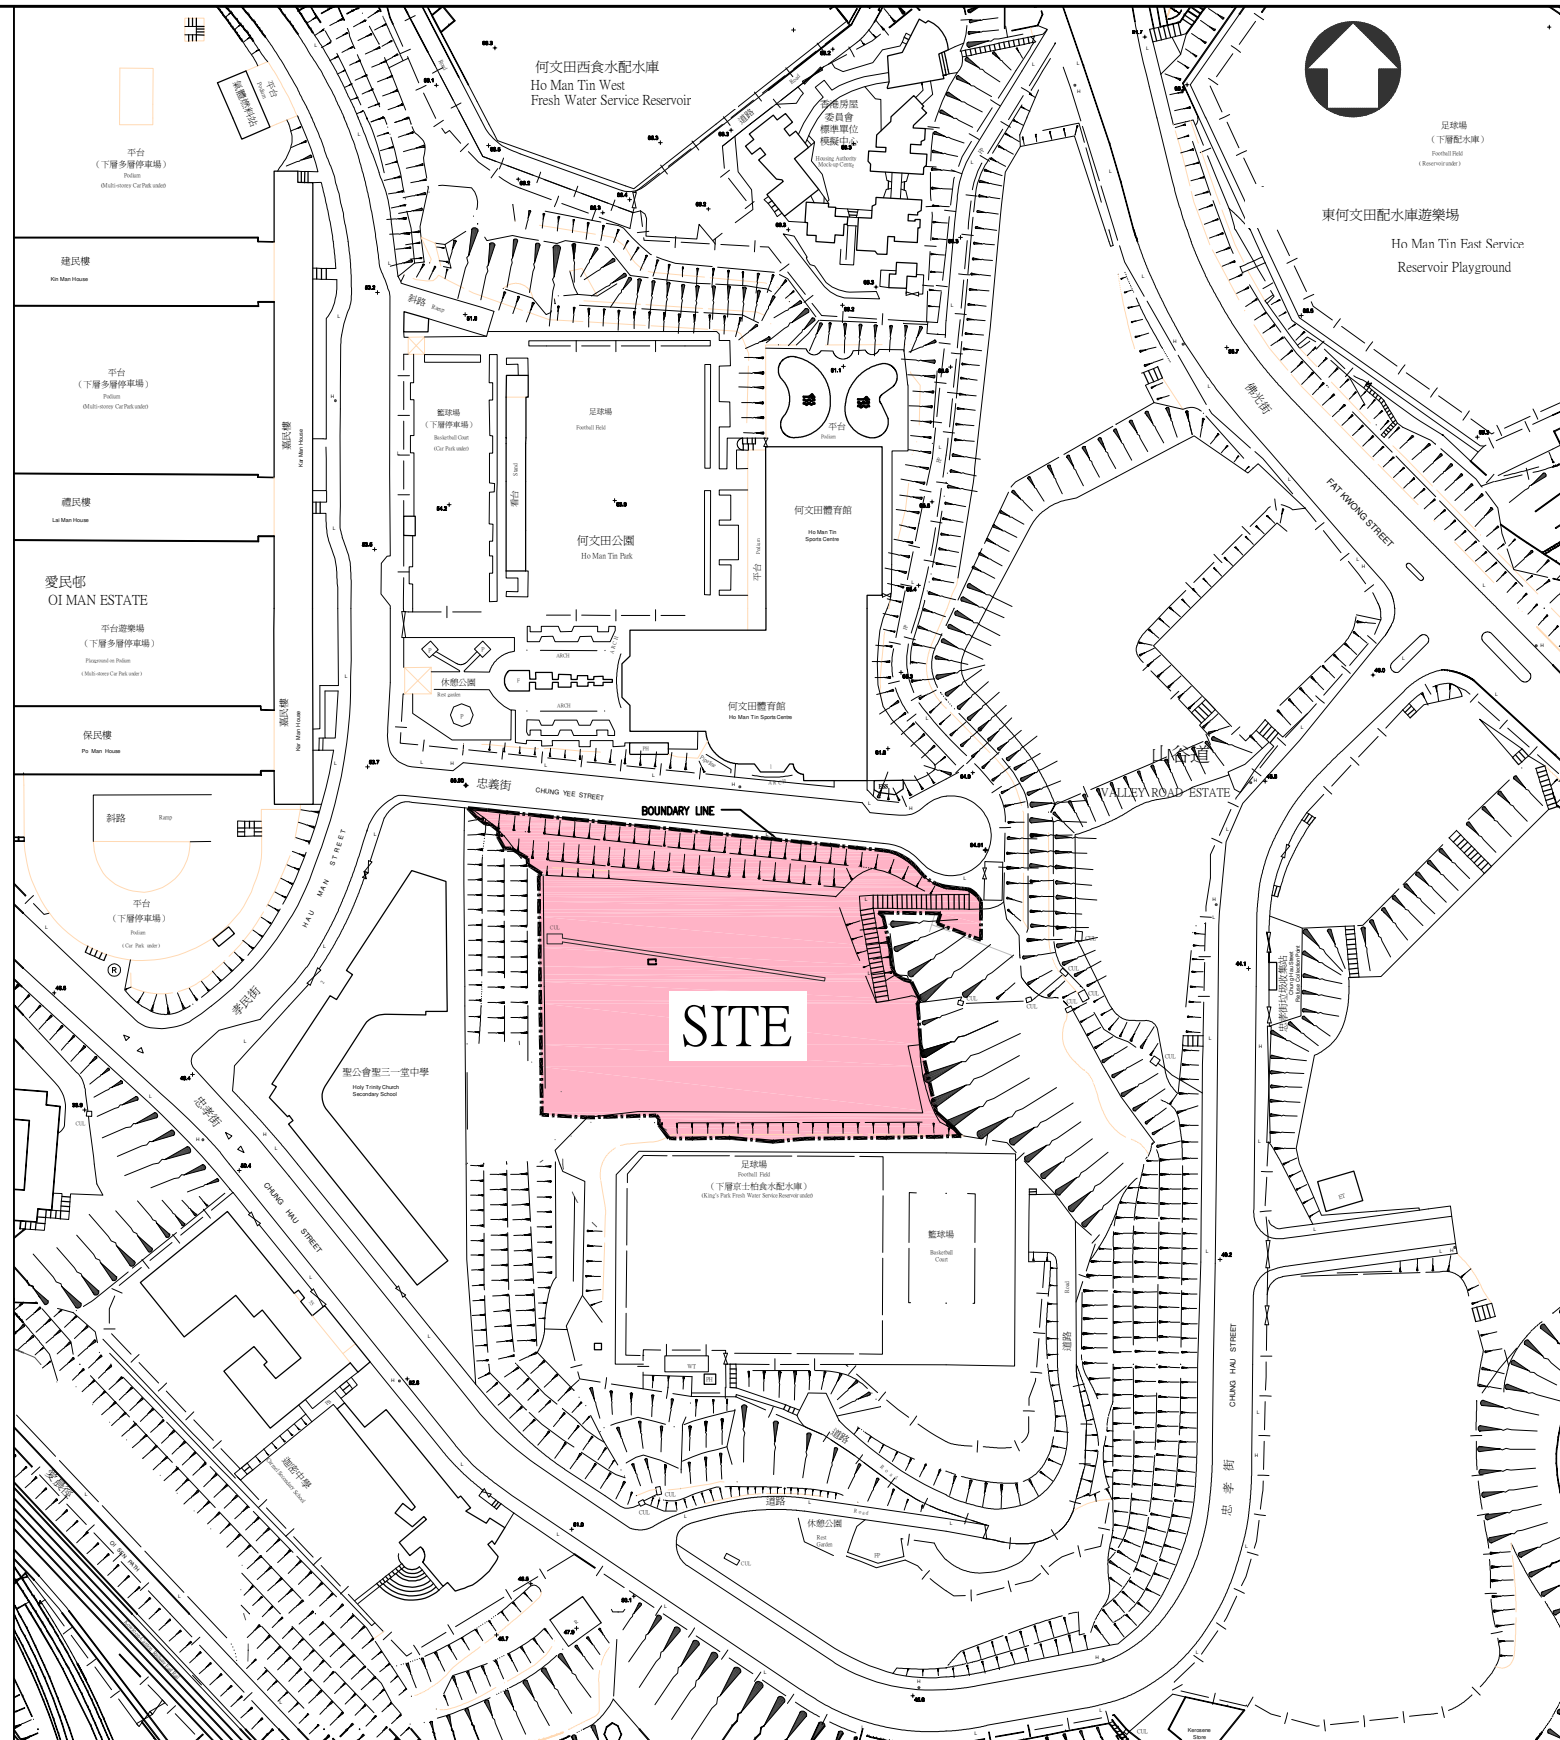

**SITE PLAN**  
SCALE 1 : 1000

Notes :

No.	Date	Description	Initial
Revision			

Consultant Project No. 080101

**ARTHUR C. S. KWOK**  
ARCHITECTS & ASSOCIATES LIMITED  
郭克昇建築師有限公司  
1401 ARGYLE CENTRE ONE KOWLOON

**TEAM 73 HK Limited**  
urban design urban planning landscape architecture  
4/F Chee Hong Kong Tower & Homeway Road, Hong Kong  
Tel: 2885-8713 Fax: 2885-4828 Email: design@team73.com

**CANWEST CONSULTANTS LIMITED**  
CIVIL & STRUCTURAL ENGINEERS  
建築工程師有限公司  
18/F, 433 HONG KONG ROAD, NORTH POINT, HONG KONG  
TEL: (852) 2885 1128  
FAX: (852) 2881 4349  
E-MAIL: canwest@canwest.com.hk

**THOMAS ANDERSON & PARTNERS**  
(H.K.) LIMITED  
CONSULTING ENGINEERS, BUILDING SERVICES  
湯瑪士(香港)有限公司

	Name	Signed	Date
Designed	PT/EL	<i>PT/EL</i>	DEC 2011
Drawn	WS	<i>WS</i>	DEC 2011
Checked	TH	<i>TH</i>	DEC 2011
Approved	AL	<i>AL</i>	DEC 2011

Contract No. SS T320

File No.

Project No. 420 R0

Consultant Agreement No. 9AS022

Contract LOCAL OPEN SPACE AT CHUNG YEE STREET, KOWLOON CITY DISTRICT

Drawing Title **HOARDING GENERAL NOTES & SITE PLAN**

Drawing No.	Scale
AB/2263/EW001	A1 = 1 : 1000 A3 = 1 : 2000

(Date)

**ARCHITECTURAL SERVICES DEPARTMENT**